

#### **Outdoor sensor Temperature**

Active sensor (0...10 V) for measuring temperature in outdoor areas. Typical applications at cold stores, greenhouses, production plants and warehouses. NEMA 4X / IP65 rated enclosure.

# **Technical data sheet**





22UT-52

5-year warranty





Type Overview				
	Туре	Output signal active temperature	Additional features	
	22UT-52	05 V, 010 V	External Sensor	

Technical data					
Electrical Data	Nominal voltage	AC/DC 24	·V		
	Nominal voltage range	AC 21.6	26.4 V / DC 13.5	26.4 V	
	Power consumption AC	0.8 VA			
	Power consumption DC	0.4 W	0.4 W		
	Electrical connection	Pluggable spring loaded terminal block max. 2.5 mm²			
	Cable entry	•	nd with strain re luit adapter incl		า (1/2"
Functional Data	Sensor Technology	based on	based on Pt1000 1/3 DIN  air  8 measuring ranges selectable  1 x 05 V, 010 V, min. resistance 5 kΩ  output 05/10 V with jumper adjustable  Temperature		
	Application	air			
	Multirange	8 measur			
	Voltage output	1 x 05 V			
	Output signal active note	output 0.			le
Measuring Data	Measured values	Tempera			
_	Measuring range temperature				
		Active sensor: range selectable Attention: max. measuring temperature is restricted by max. fluid temperature (see Safety data)			
		Setting	Range [°C]	Range [°F]	Factory setting
		S0	-5050	-30130	~
		S1	-10120	0250	
		S2	050	40140	
		S3	0250	30480	
		S4 S5	-1535 0100	0100 40240	
		56	-2080	40240	
		S7	0160	0150	
	Accuracy temperature active		±0.5°C @ 21°C [±0.9°F @ 70°F] @ measuring range setting S2 and S4		
	Long-term stability	±0.07°F p.a. @ 70°F [±0.04°C p.a. @ 21°C] [±39.2°F p.a. @ 69.8°F]			
	Long-term stability				
	Time constant $\tau$ (63%) in the room	Typical 54	12 s		
Materials	Cable gland	PA6, blac	k		
	Mounting plate	PC, grey l	RAI 7001		



## Technical data sheet 22UT-52

Materials	Housing	Cover: PC, orange
		Bottom: PC, orange
		Seal: NBR70, black
		UV resistant
		UL94 5VA

#### Safety Data

Protection class IFC/FN	III, Protective Extra-Low Voltage (PELV)
Power source UI	Class 2 Supply
Degree of protection IEC/EN	IP65
	NEMA 4X
Degree of protection NEMA/UL	
Enclosure	UL Enclosure Type 4X
EU Conformity	CE Marking
Certification IEC/EN	IEC/EN 60730-1
Quality Standard	ISO 9001
UL 2043 Compliant	Suitable for use in air plenums per Section 300.22(C) of the NEC and Section 602 of the IMC
Type of action	Type 1
Rated impulse voltage supply	0.8 kV
Installation method	Independently mounted control
Pollution degree	3
Ambient humidity	Max. 95% RH, non-condensing
Ambient temperature	-3550°C [-30122°F]
Fluid temperature	-3550°C [-30122°F]
Housing surface temperature	max. 160°F [70°C]
Pollution degree Ambient humidity Ambient temperature Fluid temperature	3  Max. 95% RH, non-condensing  -3550°C [-30122°F]  -3550°C [-30122°F]

#### **Safety Notes**



This device has been designed for use in stationary heating, ventilation and air-conditioning systems and must not be used outside the specified field of application. Unauthorized modifications are prohibited. The product must not be used in relation with any equipment that in case of a failure may threaten humans, animals or assets.

Ensure all power is disconnected before installing. Do not connect to live/operating equipment. Only authorized specialists may carry out installation. All applicable legal or institutional

installation regulations must be complied during installation.

The device contains electrical and electronic components and must not be disposed of as household refuse. All locally valid regulations and requirements must be observed.

#### Remarks

## **General Remarks Concerning Sensors**

When using lengthy connection wires (depending on the cross section used) the measuring result might be falsified due to a voltage drop at the common GND-wire (caused by the voltage current and the line resistance). In this case, 2 GND-wires must be wired to the sensor - one for supply voltage and one for the measuring current.

Sensing devices with a transducer should always be operated in the middle of the measuring range to avoid deviations at the measuring end points. The ambient temperature of transducer electronics should be kept constant. The transducers must be operated at a constant supply voltage  $(\pm 0.2 \text{ V})$ . When switching the supply voltage on/off, onsite power surges must be avoided.


## Parts included

Parts included	Description	Туре
	Mounting plate S housing	A-22D-A09
	Dowels	
	Screws	

1/2" NPT conduit adapter



## **Wiring Diagram**

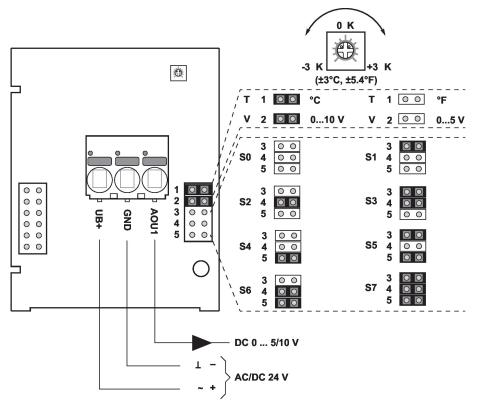



The adjustment of the measuring ranges is made by changing the bonding jumpers. The output value in the new measuring range is available after 2 seconds.

Setting	Range [°C]	Range [°F]	Factory setting
S0	-5050	-30130	<b>*</b>
S1	-10120	0250	
S2	050	40140	
S3	0250	30480	
S4	-1535	0100	
S5	0100	40240	
S6	-2080	4090	
S7	0160	0150	



## **Dimensions**

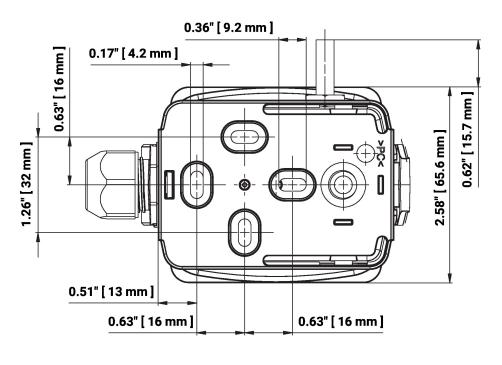

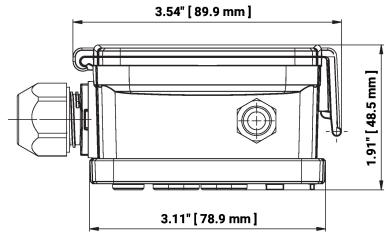

Туре	Probe length	Weight
22UT-52	1" [25 mm]	0.29 lb [0.13 kg]

#### **Further documentation**

• Installation instructions