

Resilient Seat, 304 Stainless Steel Disc

Butterfly Valve with Lug types

- Disc 304 stainless steel
- Bubble tight shut-off
- Resilient seat
- Valve face-to-face dimensions comply with API 609 & MSS-SP-67
- Completely assembled and tested, ready for installation





Type overview		
Туре		DN
F765HD		65
Technical data		
Functiona	data Valve size [mm]	2.5" [65]
	Fluid	chilled or hot water, up to 60% glycol
	Fluid Temp Range (water)	-22250°F [-30120°C]
	Body Pressure Rating	ANSI Class Consistent with 125, 232 psi CWP
	Close-off pressure Δps	200 psi
	Flow characteristic	modified linear
	Servicing	maintenance-free
	Flow Pattern	3-way Mixing/Diverting
	Leakage rate	0%
	Controllable flow range	90° rotation
	Cv	196
	Maximum Velocity	12 FPS
	Lug threads	5/8-11 UNC
Mat	erials Valve body	Ductile cast iron ASTM A536
	Body finish	epoxy powder coating (blue RAL 5002)
	Stem	416 stainless steel
	Seat	EPDM
	Pipe connection	for use with ANSI class 125/150 flanges
	Bearing	RPTFE
	Disc	304 stainless steel
	Gear operator materials	Gears - hardened steel
Suitable actu	ators Non-Spring	GMB(X)


Dimensions

Туре	DN	Weight
F765HD	65	41.8 lb [19 kg]


Spring


(2*AFB(X))



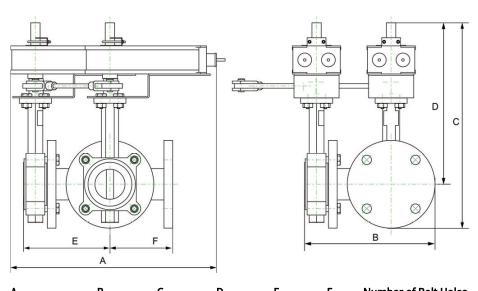


Valve with 2*AFX Actuator




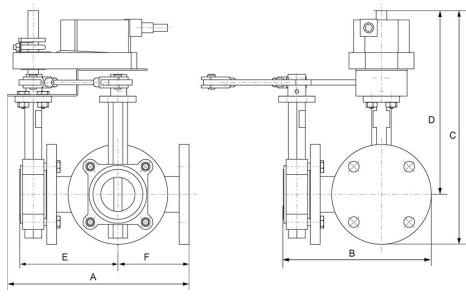


Valve with GK/GM Actuator

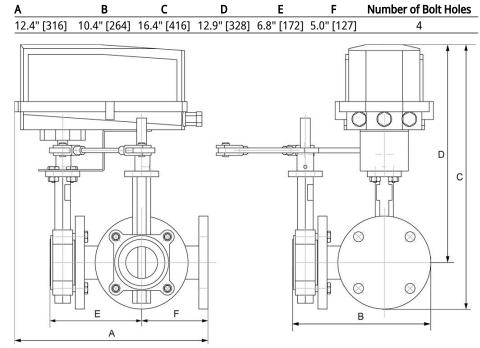

Valve with GM..N4 Actuator

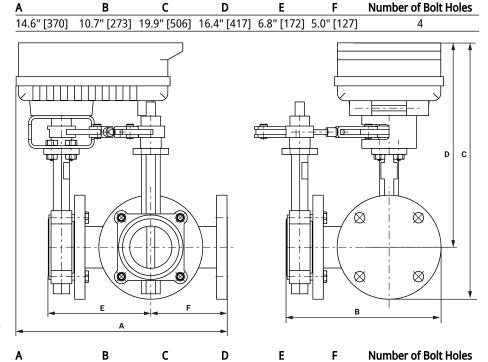

Valve with PR Actuator

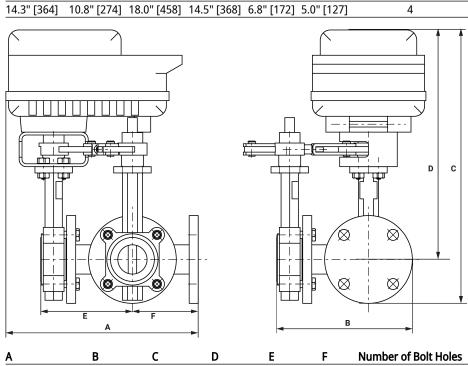

Valve with PK Actuator

Α	В	С	D	E	F	Number of Bolt Holes
14.3" [364]	10.8" [274]	19.7" [501]	16.2" [411]	6.8" [172]	5.0" [127]	4



Technical data

Modulating, Electrical Fail-Safe, 24 V, for DC 2...10 V or 4...20 mA Control Signal









Electrical data	Nominal voltage	AC/DC 24 V
	Nominal voltage frequency	50/60 Hz
	Power consumption in operation	12 W
	Power consumption in rest position	3 W
	Transformer sizing	21 VA (class 2 power source)
	Electrical Connection	18 GA plenum cable with 1/2" conduit connector, degree of protection NEMA 2 / IP54, 3 ft [1 m] 10 ft [3 m] and 16ft [5 m]
	Overload Protection	electronic throughout 095° rotation
Functional data	Operating range Y	210 V
	Operating range Y note	420 mA w/ ZG-R01 (500 Ω , 1/4 W resistor)
	Input Impedance	100 k Ω for 210 V (0.1 mA), 500 Ω for 420 mA, 1500 Ω for PWM, On/Off and Floating point
	Operating range Y variable	Start point 0.530 V End point 2.532 V
	Options positioning signal	variable (VDC, on/off, floating point)
	Position feedback U	210 V
	Position feedback U note	Max. 0.5 mA
	Position feedback U variable	VDC variable
	Bridging time (PF)	2 s

Bridging time (PF) variable

Direction of motion fail-safe

Pre-charging time
Direction of motion motor

Manual override

Angle of rotation

Angle of rotation note

Running Time (Motor)	150 s / 90°
Running time motor variable	95150 s
Running time fail-safe	<35 s
Noise level, motor	52 dB(A)
Noise level, fail-safe	61 dB(A)

Position indication		Mechanically, 3065 mm stroke	
Safety data	Degree of protection IEC/EN	IP54	

Degree of protection IEC/EN IP54

Degree of protection NEMA/UL NEMA 2

Enclosure UL Enclosure Type 2

0...10 s 5...20 s

Max. 95°

selectable with switch 0/1

adjustable with mechanical stop

reversible with switch

external push button



	Technical data sheet	GKX24-MFT-X1
Safety data	Agency Listing	cULus acc. to UL60730-1A/-2-14, CAN/CSA E60730-1:02, CE acc. to 2014/30/EU and 2014/35/EU; Listed to UL 2043 - suitable for us in air plenums per Section 300.22(c) of the NEG and Section 602.2 of the IMC
	Quality Standard	ISO 9001
	Ambient temperature	-22122°F [-3050°C]
	Storage temperature	-40176°F [-4080°C]
	Ambient humidity	Max. 95% RH, non-condensing
	Servicing	maintenance-free

†Rated Impulse Voltage 800V, Type of action 1.AA, Control Pollution Degree 3 **Footnotes**

Product features

Bridging time

Materials

Housing material

Electrical interruptions can be bridged up to a maximum of 10 s.

In the event of a power failure, the actuator will remain stationary in accordance with the set bridging time. If the power failure is greater than the set bridging time, then the actuator will move into the selected fail-safe position.

Galvanized steel and plastic housing

The bridging time set ex-works is 2 s. This can be modified on site in operation with the use of the Belimo service tool MFT-P.

Settings: The rotary knob must not be set to the "PROG FAIL-SAFE" position!

For retroactive adjustments of the bridging time with the Belimo service tool MFT-P or with the ZTH EU adjustment and diagnostic device only the values need to be entered.

Accessories

E	lectr	ical	accessories

Description	Туре
Feedback potentiometer 140 Ω add-on, grey	P140A GR
Feedback potentiometer 500 Ω add-on, grey	P500A GR
Feedback potentiometer 1 k Ω add-on, grey	P1000A GR
Feedback potentiometer 2.8 kΩ add-on, grey	P2800A GR
Feedback potentiometer 5 k Ω add-on, grey	P5000A GR
Feedback potentiometer 10 kΩ add-on, grey	P10000A GR
Auxiliary switch 1 x SPDT add-on	S1A
Auxiliary switch 2 x SPDT add-on	S2A
Service Tool, with ZIP-USB function, for programmable and	ZTH US
communicative Belimo actuators, VAV controller and HVAC perform	ance
devices	

Electrical installation



X INSTALLATION NOTES

A) Actuators with appliance cables are numbered.

Rrovide overload protection and disconnect as required.

Actuators may also be powered by DC 24 V.

Only connect common to negative (-) leg of control circuits.

 Λ A 500 Ω resistor (ZG-R01) converts the 4...20 mA control signal to 2...10 V.

Control signal may be pulsed from either the Hot (Source) or Common (Sink) 24 V line. A For triac sink the Common connection from the actuator must be connected to the Hot connection of the controller. Position feedback cannot be used with a triac sink controller; the actuator internal common reference is not compatible.

🔼 IN4004 or IN4007 diode. (IN4007 supplied, Belimo part number 40155).

Actuators may be controlled in parallel. Current draw and input impedance must be observed. Master-Slave wiring required for piggy-back applications. Feedback from Master to control input(s) of Slave(s).

Meets cULus requirements without the need of an electrical ground connection.





/ Warning! Live electrical components!

During installation, testing, servicing and troubleshooting of this product, it may be necessary to work with live electrical components. Have a qualified licensed electrician or other individual who has been properly trained in handling live electrical components perform these tasks. Failure to follow all electrical safety precautions when exposed to live electrical components could result in death or serious injury.

